



VALLEY TESTING AND ENGINEERING

#18 - 3275 McCallum Road ph: 1-888-855-9733
 Abbotsford, B.C. V2S 7W8 fax: (604) 855-7378

**SIEVE ANALYSIS REPORT
 8 16 30 50 SERIES**

TO LINTERRA AGGREGATES

PROJECT NO. V6590
 CLIENT LINTERRA AGGREGATES
 C.C. LINTERRA AGGREGATES


ATTN: HELLEN HOWELL

PROJECT CULTUS LAKE AGGREGATES
 MATERIALS TESTING
 CONTRACTOR LINTERRA AGGREGATES

VEDDER ROAD
 CHILLIWACK

SIEVE TEST NO. 180 DATE RECEIVED 2017.Mar.07 DATE TESTED 2017.Mar.08 DATE SAMPLED 2017.Mar.07

SUPPLIER LINTERRA AGGREGATES SOURCE CULTUS LAKE PIT SPECIFICATION MMCD DRAIN ROCK (COARSE) MATERIAL TYPE 25 mm CLEAR
 SAMPLED BY CLIENT TESTED BY CF/JR TEST METHOD ASTM C-136

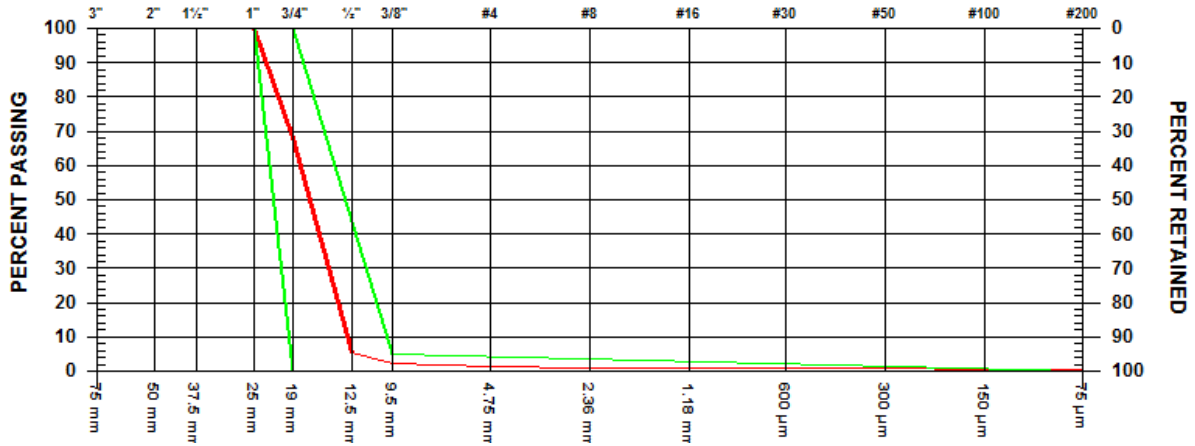

GRAVEL SIZES	PERCENT PASSING	GRADATION LIMITS
3" 75 mm		
2" 50 mm		
1 1/2" 37.5 mm		
1" 25 mm	100.0	100.0-100.0
3/4" 19 mm	68.0	0.0-100.0
1/2" 12.5 mm	5.5	
3/8" 9.5 mm	2.1	0.0-5.0

SAND SIZES AND FINES	PERCENT PASSING	GRADATION LIMITS
No. 4 4.75 mm	1.2	
No. 8 2.36 mm	1.0	
No. 16 1.18 mm	0.8	
No. 30 600 µm	0.8	
No. 50 300 µm	0.7	
No. 100 150 µm	0.5	
No. 200 75 µm	0.5	

COMMENTS