



VALLEY TESTING AND ENGINEERING

#18 - 3275 McCallum Road ph: 1-888-855-9733
 Abbotsford, B.C. V2S 7W8 fax: (604) 855-7378

**SIEVE ANALYSIS REPORT
 8 16 30 50 SERIES**

TO Site LINTERRA AGGREGATES
 375 UNIT #8 6014 VEDDER RD.
 CHILLIWACK, BC, BC

PROJECT NO. V6590
 CLIENT LINTERRA AGGREGATES
 C.C. LINTERRA AGGREGATES


ATTN: PETER SLOOTWEG

PROJECT CULTUS LAKE AGGREGATES
 MATERIALS TESTING
 CONTRACTOR LINTERRA AGGREGATES

VEDDER ROAD
 CHILLIWACK

SIEVE TEST NO. 176 DATE RECEIVED 2017.Feb.01 DATE TESTED 2017.Feb.01 DATE SAMPLED 2017.Feb.01

SUPPLIER LINTERRA AGGREGATES SOURCE CULTUS LAKE PIT SPECIFICATION MMCD GRANULAR BASE MATERIAL TYPE 19 mm CRUSHED
 SAMPLED BY CLIENT TESTED BY JR TEST METHOD ASTM C-136

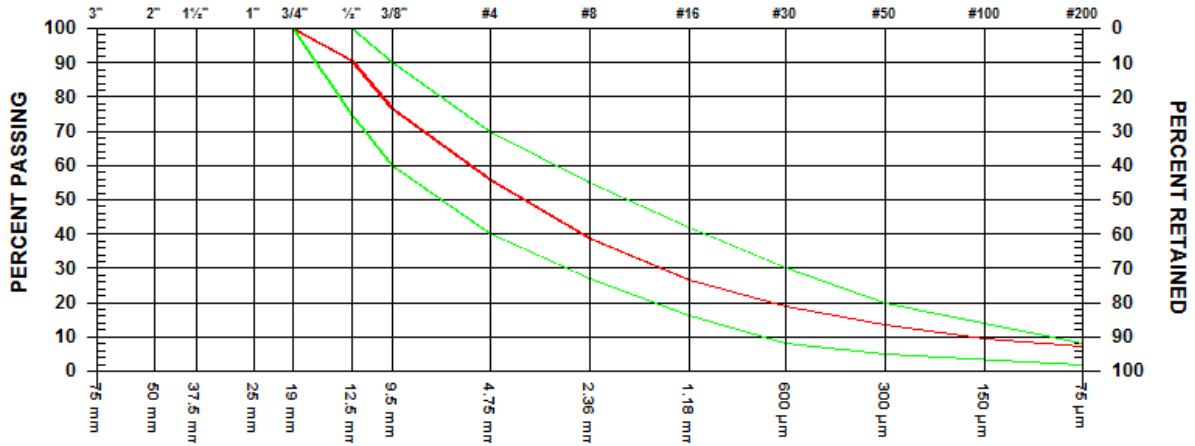

GRAVEL SIZES	PERCENT PASSING	GRADATION LIMITS
3"	75 mm	
2"	50 mm	
1 1/2"	37.5 mm	
1"	25 mm	
3/4"	19 mm	100.0 - 100.0
1/2"	12.5 mm	90.4 - 75.0 - 100.0
3/8"	9.5 mm	76.6 - 60.0 - 90.0

SAND SIZES AND FINES	PERCENT PASSING	GRADATION LIMITS
No. 4	4.75 mm	55.9 - 40.0 - 70.0
No. 8	2.36 mm	38.8 - 27.0 - 55.0
No. 16	1.18 mm	26.7 - 16.0 - 42.0
No. 30	600 µm	18.8 - 8.0 - 30.0
No. 50	300 µm	13.4 - 5.0 - 20.0
No. 100	150 µm	9.5 - 2.0 - 8.0
No. 200	75 µm	7.3 - 2.0 - 8.0

COMMENTS